



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

TKO Doors, Div. of 4Front Engineered Solutions, Inc.
N56 W24701 N. Corporate Circle
Sussex, WI 53089

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model VC-2 WL Plastic Sectional Garage Door up to 10'-0" Wide x 12'-0" High

APPROVAL DOCUMENT: Drawing No. 13-TKO-0302, titled "Fiberglass Dock Doors VC-2 WL Overhead Garage Door", sheet 1 through 7 of 7, dated 05/06/2013, with last revision dated 01/24/2014, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by Carlos M. Utrera, P.E.



[Signature]
02/28/2014

NOA No 13-0521.05
Expiration Date: March 13, 2019
Approval Date: March 13, 2014
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **13-TKO-0302**, titled "Fiberglass Dock Doors VC-2 WL Overhead Garage Door", sheet 1 through 7 of 7, dated 05/06/2013, with last revision dated 01/24/2014, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

B. TESTS

1. Addendum letter to Test Report No. **C3614.01-602-18**, dated 09/09/2013, signed and sealed by Shawn G. Collins, P.E.
2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC TAS 202-94
Along with marked-up drawings and installation diagram of Verticool Doors, prepared by Architectural Testing, Inc., Test Report No. **C3614.01-602-18**, dated 03/28/2013, signed and sealed by Shawn G. Collins, P.E.
3. Test report on Self-ignition Temperature per ASTM D1929, Smoke Density Rating per ASTM D2843 and Rate of Burn per ASTM D635 of various plastic door components, prepared by Architectural Testing, Inc., Test Report No. **C2850.01-106-18**, dated 11/21/2012, signed and sealed by Gary T. Hartman, P.E.

C. CALCULATIONS

1. Jamb anchor calculations prepared by Engineering Express, dated 05/14/2013 and 01/27/2014, signed and sealed by Frank L. Bennardo, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Test report on Flame Spread Index and Smoke Developed Index per UL-723 of XEPS foam insulation, Test Report No. **BRYX.R3573** dated 07/12/2010.

F. STATEMENTS

1. Statement letter of code conformance with 2010 FBC, issued by Engineering Express, dated 05/06/2013, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest issued by Engineering Express, dated 05/06/2013, signed and sealed by Frank L. Bennardo, P.E.


02/28/2014

Carlos M. Utrera, P.E.

Product Control Examiner


NOA No 13-0521.05

Expiration Date: March 13, 2019

Approval Date: March 13, 2014

VC-2 WL DOCK DOORS

LARGE MISSILE IMPACT RESISTANT

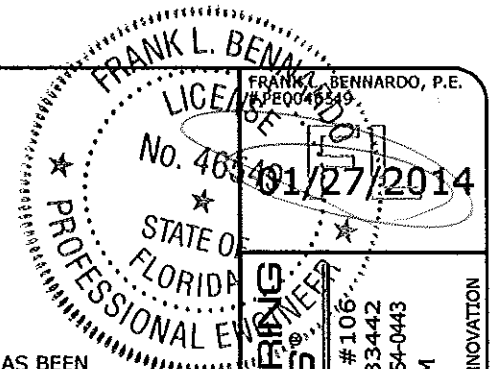

ENGINEERING EXPRESS
 160 SW 12th AVENUE, #106
 DEERFIELD BEACH, FL 33442
 PH: (954) 354-0660 FAX: (954) 354-0443
 WWW.ENGP.COM
 CERT OF AUTH #888
 A FRANK L. BENNARDO, P.E., INC. INNOVATION

GENERAL NOTES

1. THE SYSTEM DESCRIBED HEREIN HAS BEEN DESIGNED AND TESTED IN ACCORDANCE WITH THE 2010 FLORIDA BUILDING CODE, FOR USE WITHIN AND OUTSIDE THE HIGH VELOCITY HURRICANE ZONE, PER TAS 201 / 202 / 203 STANDARDS.
2. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM. WIND LOAD DURATION FACTOR $C_d=1.6$ HAS BEEN USED FOR WOOD ANCHOR DESIGN.
3. POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7 AND CHAPTER 1620 OF THE FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.
4. DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
5. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
6. CONTRACTOR SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND SUPERIMPOSED LOADS. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
7. ALL BOLTS & WASHERS SHALL BE ZINC COATED STEEL, GALVANIZED STEEL, OR STAINLESS STEEL WITH A MINIMUM TENSILE YIELD STRENGTH OF 60 KSI U.O.N.
8. ALL DISSIMILAR MATERIALS IN CONTACT SHALL BE PAINTED, PLATED OR OTHERWISE INSULATED AS PRESCRIBED IN THE ABOVE-NOTED BUILDING CODE.
9. DOOR HEIGHT MAY VARY UP TO A MAXIMUM HEIGHT OF 144", PROVIDED THAT INDIVIDUAL PANEL HEIGHTS DO NOT EXCEED 48".
10. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.

**ALLOWABLE
DESIGN PRESSURES**
 +52.0 PSF
 -52.0 PSF


Approved as complying with the
 Florida Building Code
 Date 03/13/2014
 NOA# 13-0521.05
 Miami Dade Product Control
 By *[Signature]*

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
 N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
 SUSSEX, WI 53089
 PHONE: 1-800-575-3366 FAX: (262) 246-1301
 FIBERGLASS DOCK DOORS
 VC-2 WL OVERHEAD GARAGE DOOR
 MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	05/06/13
REV. PER COMMENTS	KL	FLB	01/24/13

13-TKO-03
 SCALE: 1/2"
 PAGE DESCRIPTION:


7
 1

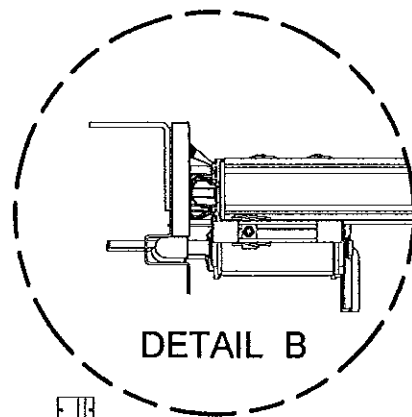

DETAIL B

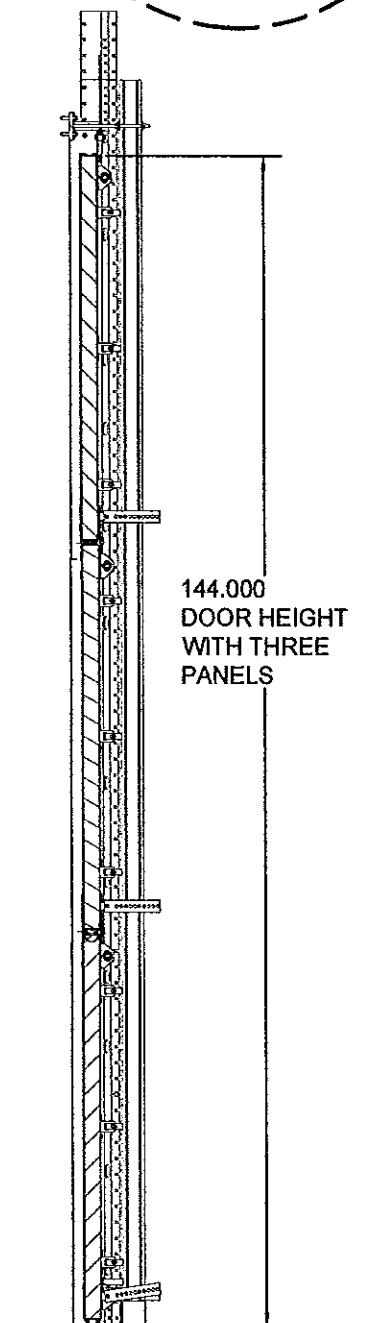





SECTION A-A
SECTION SIDE VIEW

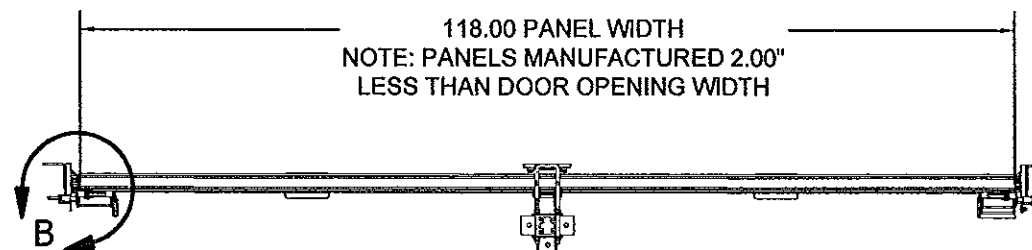

118.00 PANEL WIDTH
 NOTE: PANELS MANUFACTURED 2.00"
 LESS THAN DOOR OPENING WIDTH

PLAN VIEW

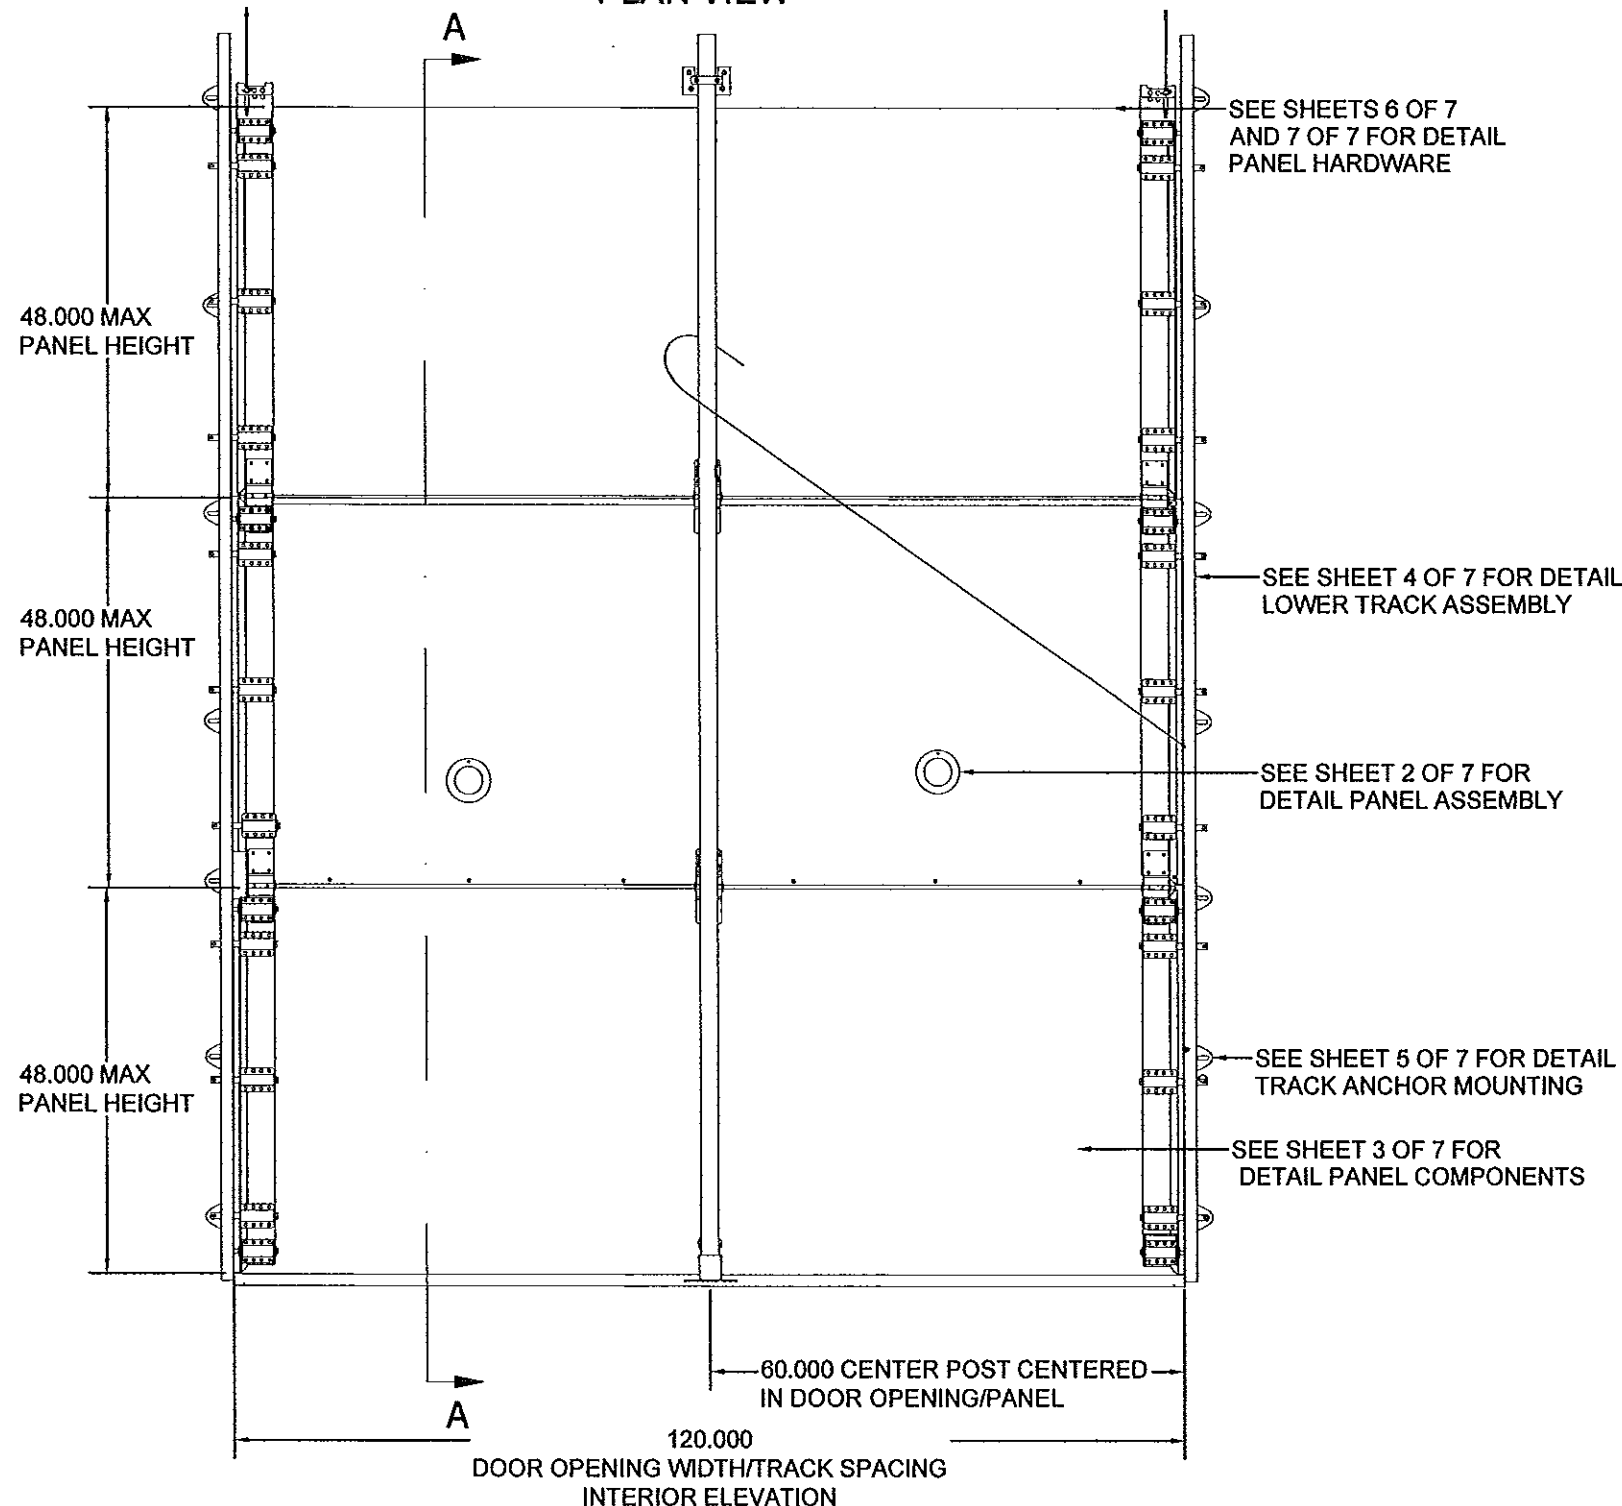

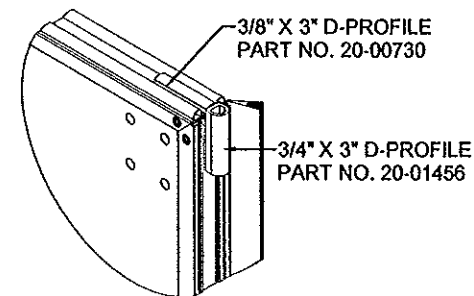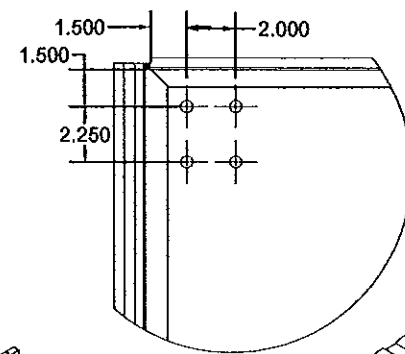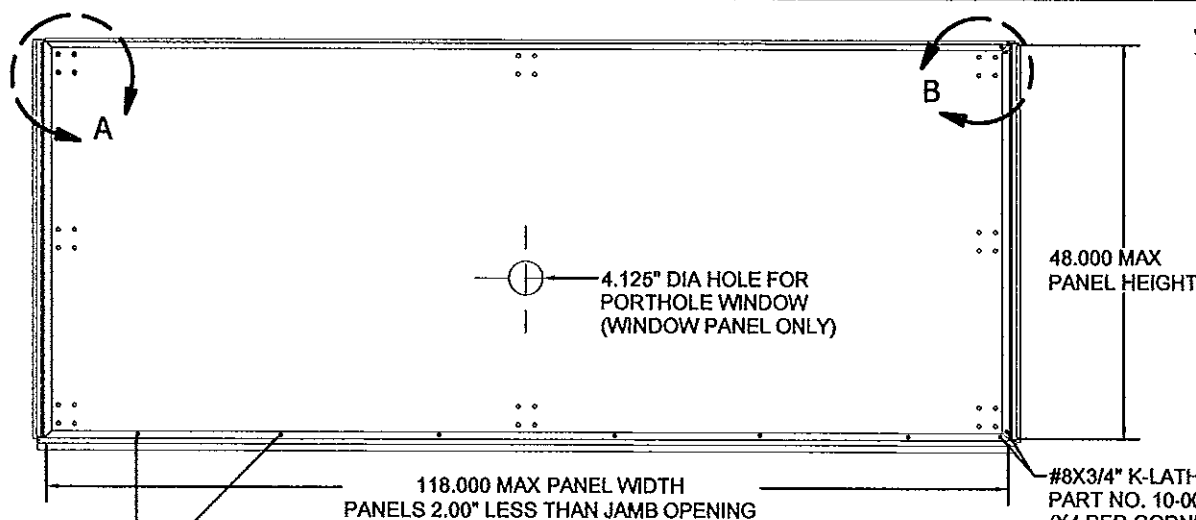

FRANK L. BENNARD, P.E.
#PE0046549
LICENSE
No. 46549
01/27/2014
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #0885
A FRANK L. BENNARD, P.E., INC. INNOVATION


TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
VC-2 WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	CHKD	DATE
INIT ISSUE	05/06/13	KL	01/24/13
REV. PER COMMENTS		KL	


13-TKO-03
SCALE: 1/2"
PAGE DESCRIPTION:
2

Approved as complying with the
Florida Building Code
Date 03/13/2014
NOA# 13-0521-05
Miami Date Product Control
By *[Signature]*


VC-2 WL PANEL COMPONENTS

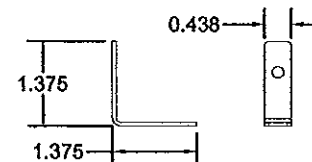

BRACKET, CORNER L, WW
PART NO. 20-00045
14-GA HRPO***, CLEAR ZINC FINISH
*** HOT-ROLLED STEEL, PICKLED & OILED




D-PROFILE, TRIM-LOK
PART NO. 20-01456
(SEE SHEET 2 OF 7 FOR LOCATION)

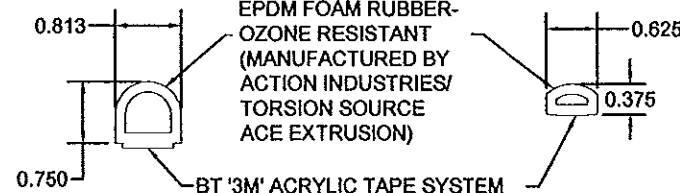


EPDM FOAM RUBBER-
OZONE RESISTANT
(MANUFACTURED BY
ACTION INDUSTRIES/
TORSION SOURCE
ACE EXTRUSION)

BT '3M' ACRYLIC TAPE SYSTEM




D-PROFILE, TRIM-LOK
PART NO. 20-00730
(SEE SHEET 2 OF 7 FOR
LOCATION)


BRUSH, NYLON FILL
BACKING, STEEL

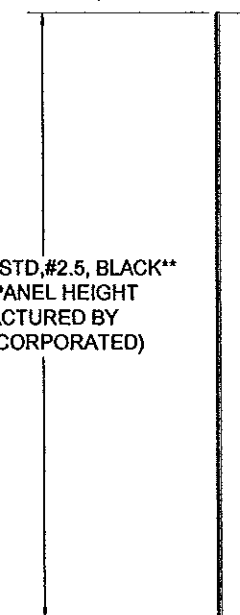

BRUSH, STD.#2.5, BLACK**
CUT TO PANEL HEIGHT
(MANUFACTURED BY
TANIS INCORPORATED)

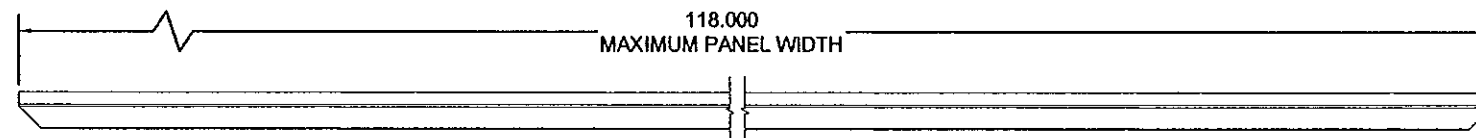


SEAL, 2" HORIZONTAL WHITE PART NO. 20-00023
(MANUFACTURED BY HI-TECH)

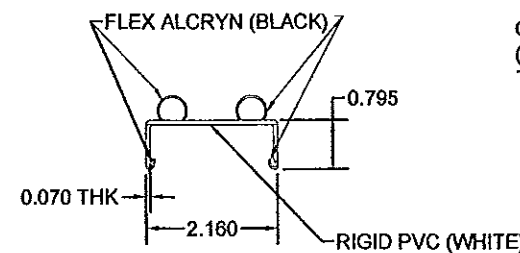

FLEX ALCRYN (BLACK)

RIGID PVC (WHITE)

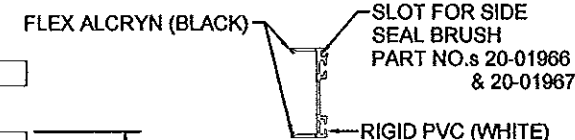


FLEX ALCRYN (BLACK)

SLOT FOR SIDE
SEAL BRUSH
PART NO.s 20-01966
& 20-01967

RIGID PVC (WHITE)

**NOTE:
-BRUSH,STD. #2.5, 1.5" BLK
48.625" PART NO. 20-01967
(BOTTOM AND INTERMEDIATE
PANELS)
-BRUSH,STD. #2.5, 1.5" BLK
48.000" PART NO. 20-01966
(TOP PANEL ONLY)

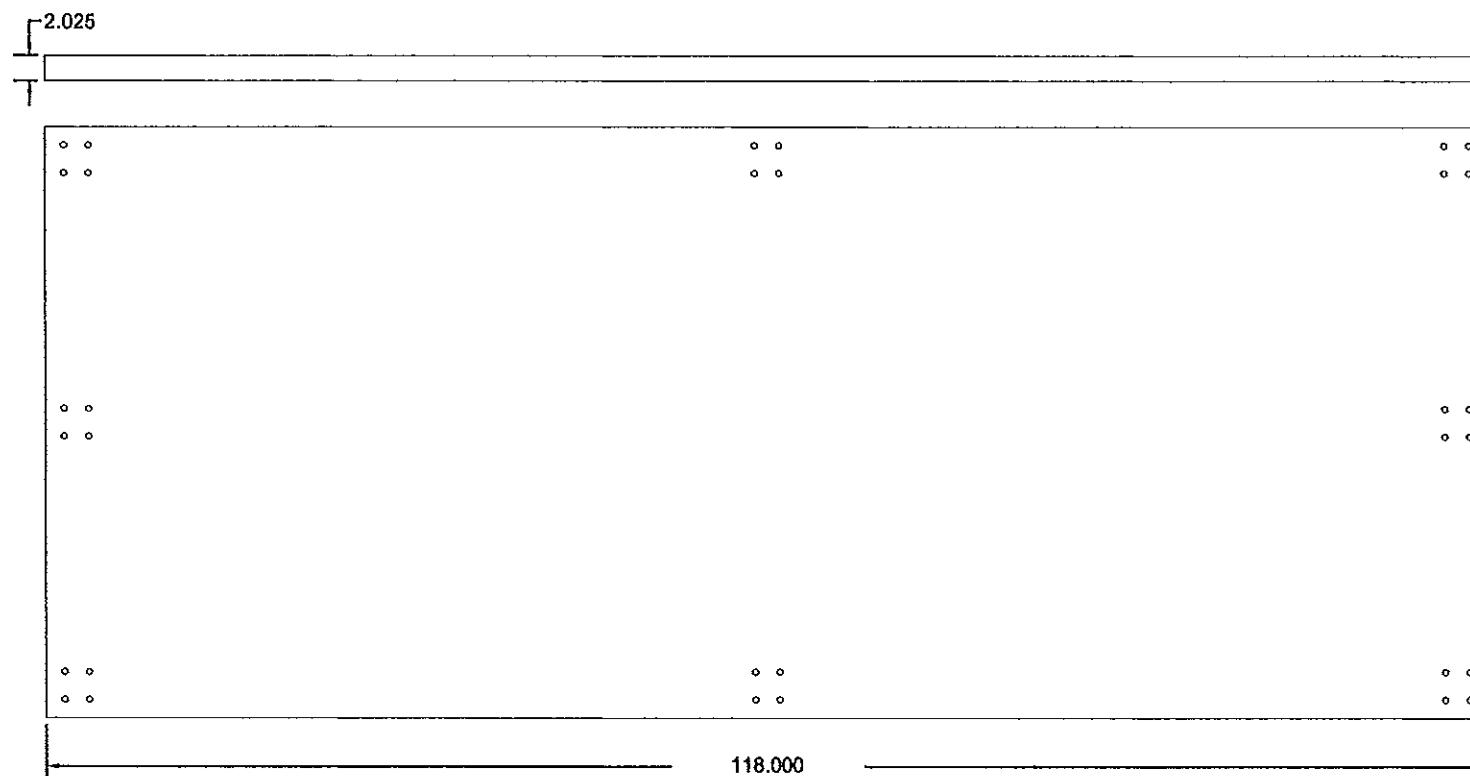


48.000 MAX
PANEL HEIGHT


SEAL 2" T-SLOT
PART NO. 20-01953
CUT TO PANEL
HEIGHT DIMENSION

SLIP-COAT, BLACK
85 DUROMETER
FLEX-COAT TPR WHITE
55 DUROMETER

SEAL, WW
SIDE LOOP, BLACK*
PNO.s 20-01825 & 20-01826
CUT TO PANEL HEIGHT




SEAL, 2" T-SLOT WHITE PART NO. 20-00027
(MANUFACTURED BY HI-TECH)

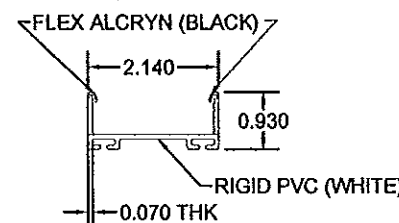


FLEX ALCRYN (BLACK)

RIGID PVC (WHITE)


*NOTE:
-SEAL, WW, SIDE LOOP, 48-3/4"
PART NO. 20-01825 (INTERMEDIATE PANEL)
-SEAL, WW, SIDE LOOP, 49-1/2"
PART NO. 20-01826 (BOTTOM PANEL ONLY)

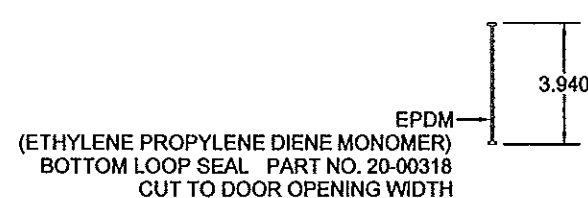

EPDM
(ETHYLENE PROPYLENE DIENE MONOMER)
BOTTOM LOOP SEAL PART NO. 20-00318
CUT TO DOOR OPENING WIDTH

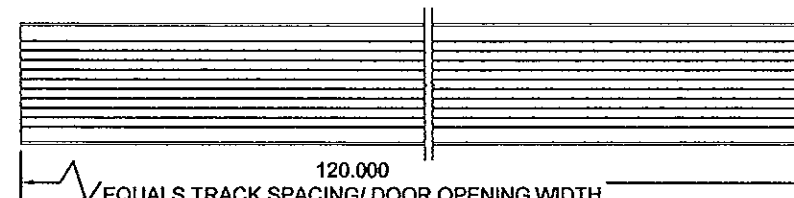

EQUALS TRACK SPACING/ DOOR OPENING WIDTH

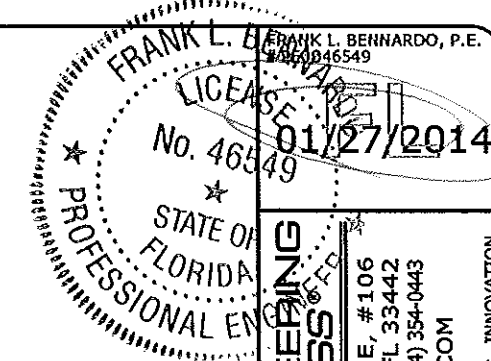



ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9865
A FRANK L. BERNARDO, P.E., INC. INNOVATION

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
VC-2 WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE



REMARKS	DATE	CHKD	DATE
INITIALS	05/06/13	KL	01/24/13
REV. PER COMMENTS		KL	

13-TKO-03
SCALE: 1/2
PAGE DESCRIPTION:

Approved as complying with the
Florida Building Code
Date 03/13/2014
NOA# 13-0521-05
Miami Dade Product Control
By *[Signature]*

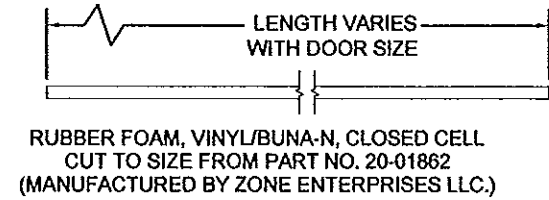


VC-2 WL LOWER TRACK ASSEMBLY

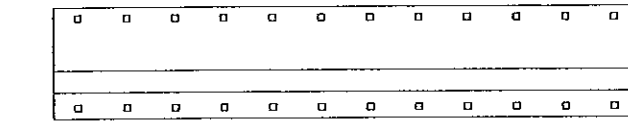
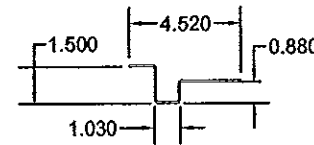


TRACK, WW, STRT EXT., 24" (ASTM: 14-GA A653 G90) (Fy=36 Ksi, MIN)
(LENGTH VARIES WITH DOOR SIZE)

LEFT HAND
SIDE TRACK

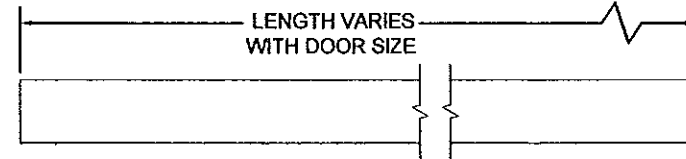

RADIANT BARRIER, ALUMINUM FOIL
CUT TO SIZE FROM PART NO. 20-01863

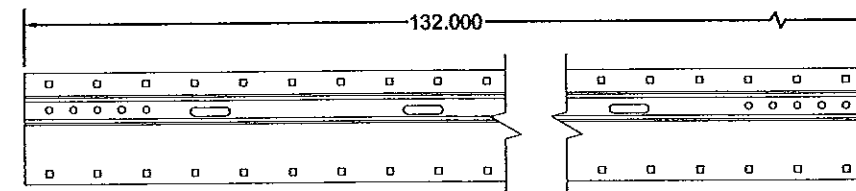

TRACK, TW STL STRT BOTTOM (ASTM: 14-GA A653 G90) (Fy=36 Ksi, MIN)
PART NO. 20-01860 (LENGTH VARIES WITH DOOR SIZE)

TRACK LINER EXT.
20-01951 RH
20-01952 LH
(LENGTH VARIES WITH DOOR SIZE)

RADIANT BARRIER
TWO-SIDED REFLECTING
ALUMINUM FOIL WITH
REINFORCED
(POLYESTER NYLON) SCRIM
PART NO. 20-01863

TRACK LINER, VC 96"
PART NO. 20-01942

SCREW, PFH, 1/4-20 X 1-1/4"
STEEL ZINC PLATED
PART NO. 10-00300

RIGHT HAND
SIDE TRACK

TRACK, WW STRT EXT.
(LENGTH VARIES WITH DOOR SIZE)


TRACK, WW, STRT EXT BRKT MOD
PART NO. 20-01601

TRACK, WW, SPLICE ANGLE, SKO
PART NO. 20-00065





3" TRACK MTG BRACKET (X14)
(7 PER SIDE LOWER TRACK)

TRACK, TW STL STRT BOTTOM
PART NO. 20-01860
(LENGTH VARIES WITH DOOR SIZE)

NUT, FLNG 1/4-20
PART NO. 10-00005




TRACK, WW, STRT EXT BRKT MOD
(ASTM: 12-GA A653 G90)
CUT TO 4.00" FROM PART NO. 20-01601






BRACKET, FLOOR TO TRACK
(8-GA HRPO**, YELLOW ZINC)
PART NO. 20-00007

TRACK LINER EXT. HDPE* RIGID POLYETHYLENE,
SMOOTH FINISH (LENGTH VARIES WITH DOOR SIZE)
* HIGH-DENSITY POLYETHYLENE

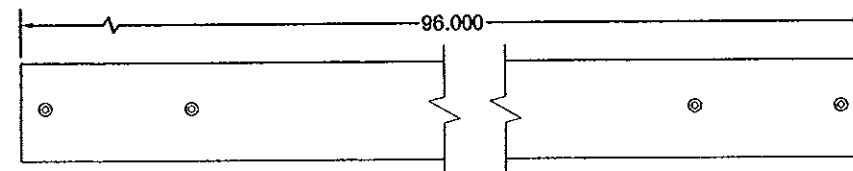

TRACK LINER, VC, 96" PART NO. 20-01942
(RIGID POLYETHYLENE HDPE*) SMOOTH FINISH
(MANUFACTURED BY QUADRANT EPP USA, INC.)

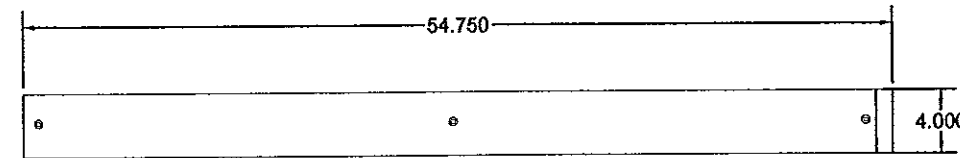


TRACK, WW, SPLICE ANGLE, SKO
12-GA HRPO**, CLEAR ZINC CHROMATE
PART NO. 20-00065
** HOT-ROLLED STEEL, PICKLED & OILED

TRACK MTG BRACKET, 3"
(ASTM: 8-GA A653 G90)
PART NO. 20-00573

Approved as complying with the
Florida Building Code
Date 03/13/2014
NOA# 12-0521.05
Miami Dade Product Control

By

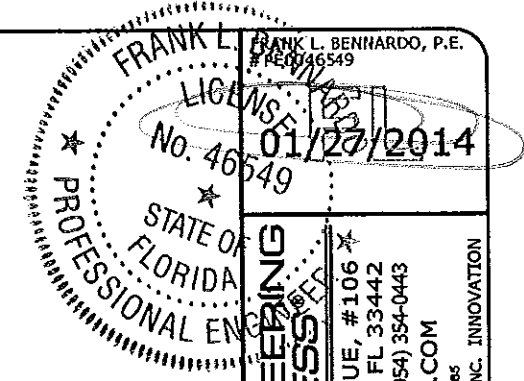

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #8885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
VC-2 WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INIT ISSUE	05/06/13	KL	FLB
REV PER COMMENTS	01/24/13	KL	FLB


13-TKO-03

SCALE: 02
PAGE DESCRIPTION:


4

VC-2 WL TRACK ANCHOR MOUNTING


STEEL ANGLE TRACK ANCHOR HOLE

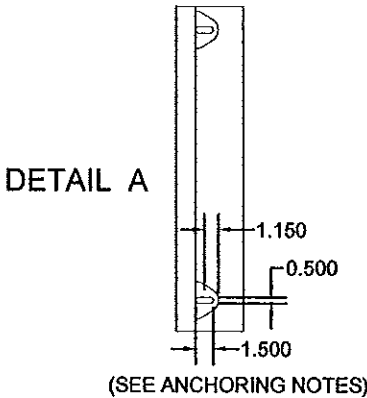


STEEL ANGLE TRACK TO BLOCK/CONCRETE

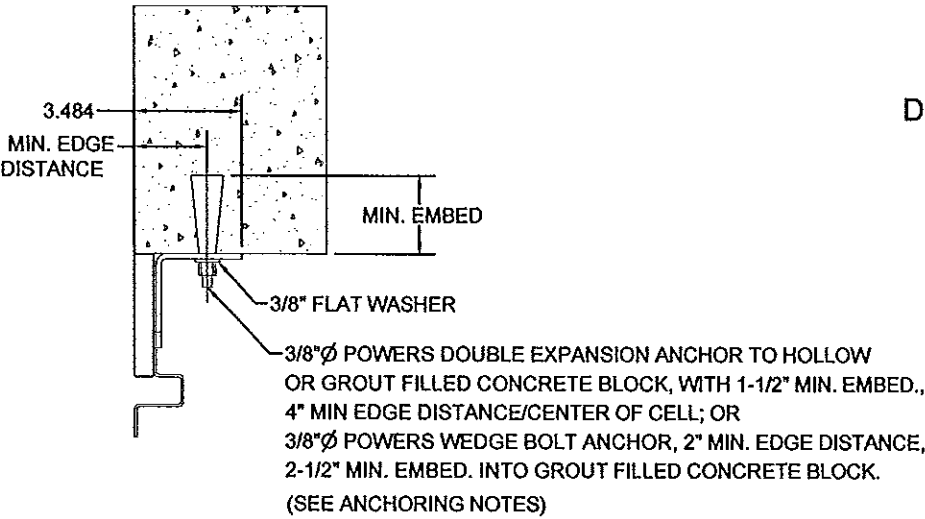


MTG BRACKET TO STEEL WITH PLUG WELD

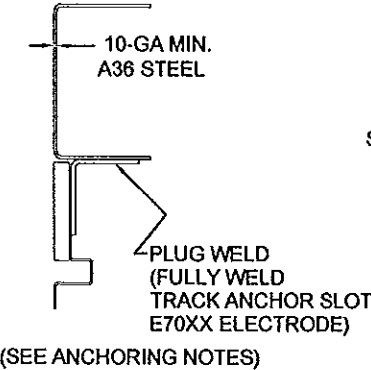

MTG BRACKET TO STEEL WITH STITCH WELD



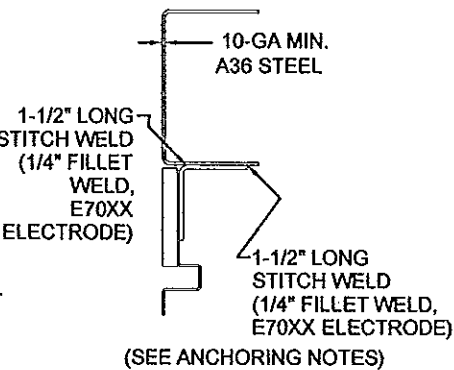


DETAIL B

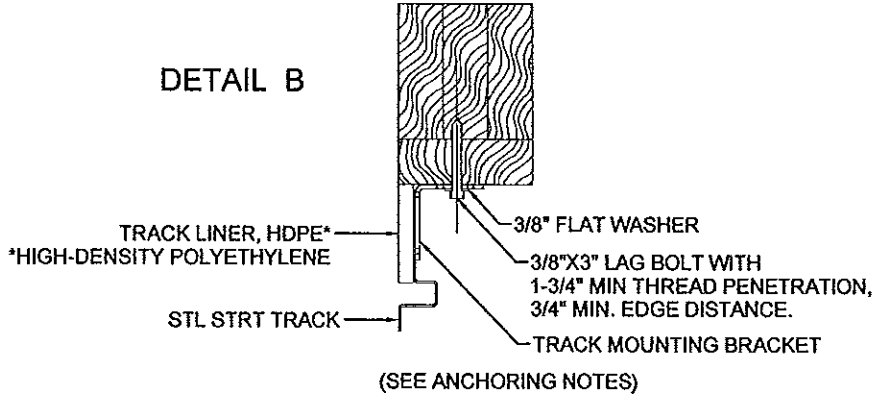

TEST MOUNTING ON WOOD

DETAIL D FLOOR TO TRACK BRACKET (SEE SHEET 4 OF 7 FOR DETAIL)

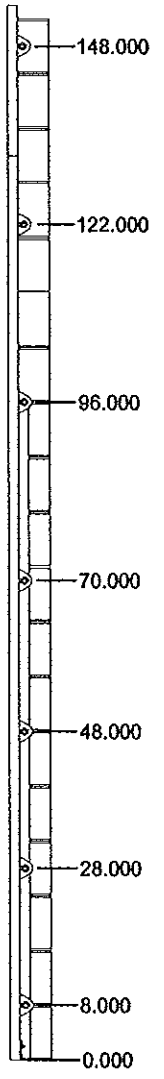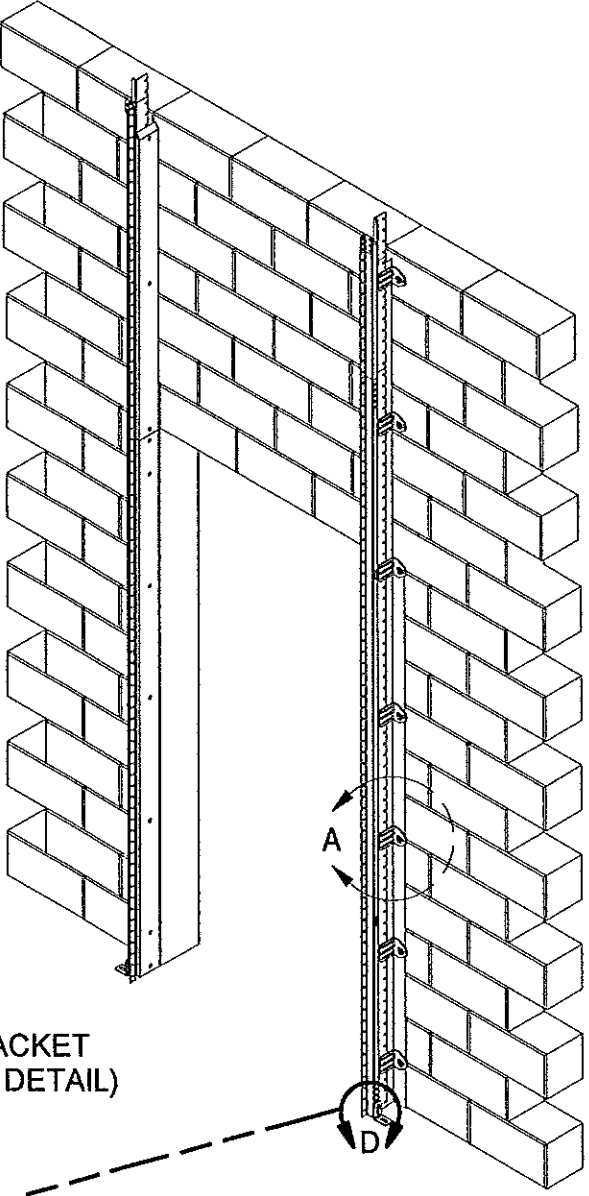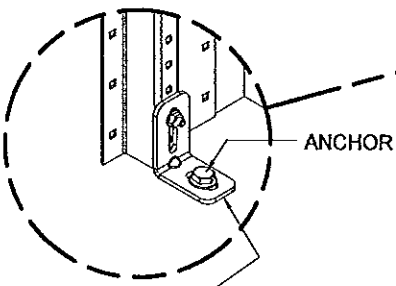

DETAIL C

ANCHORING NOTES:

1. THIS SYSTEM SHALL BE ANCHORED WITH ANY OF THE ANCHORING METHODS SHOWN HEREIN, WITH A MINIMUM OF ONE ANCHOR LOCATED 8" MAX. FROM THE BOTTOM.
 - FOR POWERS DOUBLE EXPANSION ANCHORS, THE REMAINDER OF ANCHORS SHALL BE SPACED 12" O.C. MAX.
 - FOR ALL OTHER ANCHORAGE METHODS, THE REMAINDER OF ANCHORS SHALL BE SPACED FROM BOTTOM AS SHOWN IN DETAIL C ON THIS SHEET.
2. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
3. WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, ANCHOR SHALL BE LOCATED IN CENTER OF NOMINAL 2x (MIN) WOOD STUD (i.e. 3/4" EDGE DISTANCE IS ACCEPTABLE FOR ANCHORS TO WOOD FRAMING).
4. WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
5. MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR DETAIL. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
6. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
7. WOOD BUCKS (BY OTHERS) SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
8. MACHINE SCREWS SHALL HAVE MINIMUM OF 1/2" ENGAGEMENT OF THREADS IN BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD ("SIDEWALK BOLT") U.N.O.

Approved as complying with the
Florida Building Code
Date 03/13/2014
NOAH 13-2521-05
Miami Data Product Control
By [Signature]

FRANK L. BENNARD, P.E.
#PE0046549
01/28/2014
STATE OF FLORIDA
PROFESSIONAL ENGINEER
ENGINEERING EXPRESS
160 SW 12th Avenue, #100
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0643
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARD, P.E., INC. INNOVATION

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
VC-2 WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
INIT ISSUE	KL	FLB	05/06/13
REV. PER COMMENTS	KL	FLB	01/24/13

13-TKO-03
SCALE: 1/2"
PAGE DESCRIPTION:
5

FASTENER NOTE:















FIXED PLUNGERS, HANDLES, AND TPU BRACKETS ARE MOUNTED TO THE PANEL USING: (4) 1/4-20 X 3.00" CARRIAGE BOLTS AND (4) 1/4-20 FLANGE NUTS.

HINGE SETS ARE MOUNTED TO THE PANELS USING: (4) 1/4-20 X 3.00" CARRIAGE BOLTS AND 1/4-20 FLANGE NUTS.




PANEL PLATES ARE MOUNTED TO THE PANELS USING: (10) 1/4-20 X 3.00" CARRIAGE BOLTS AND 1/4-20 FLANGE NUTS.

SLIDE LOCKS ARE MOUNTED TO THE PANELS USING: (4) #14 X 3/4" TEK SCREWS.

VC-2 WL PANEL HARDWARE

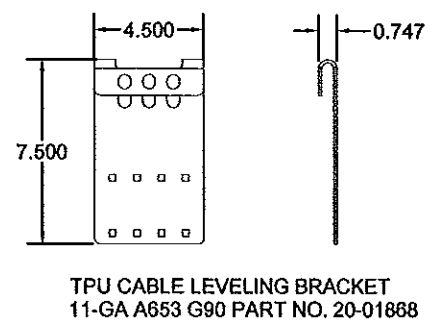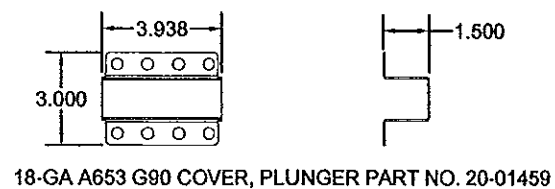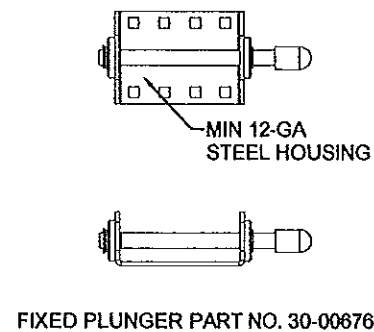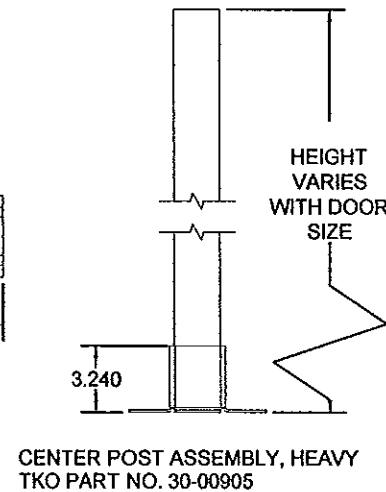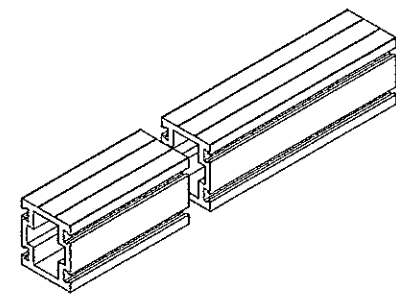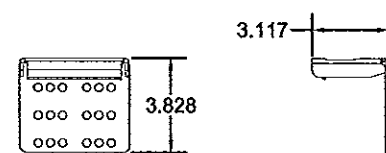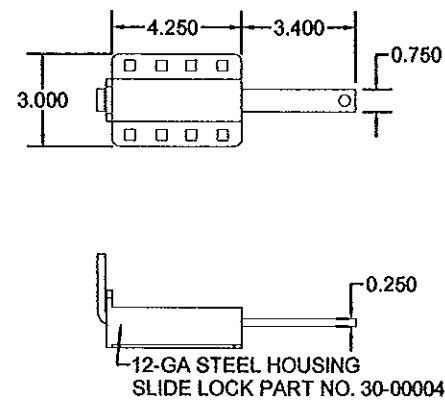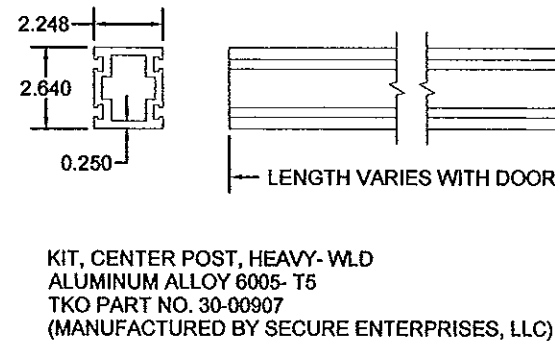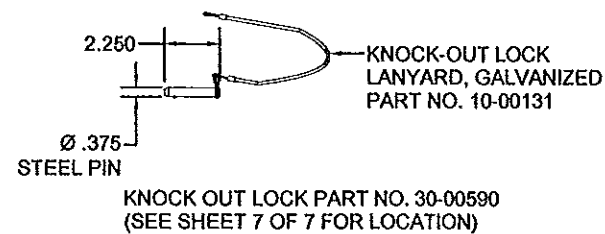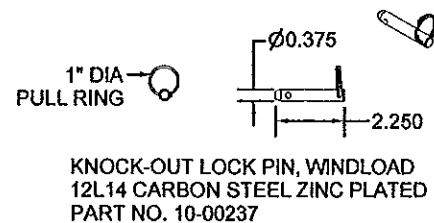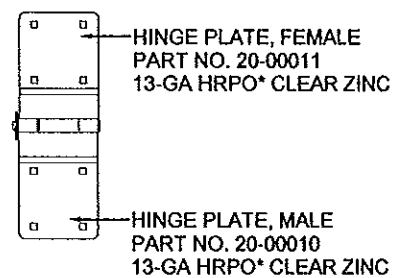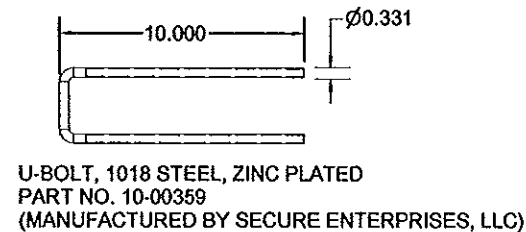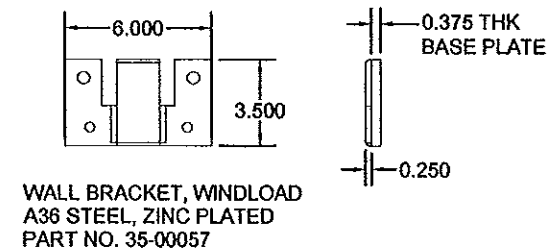

*HRPO- HOT ROLLED, PICKLED & OILED STEEL

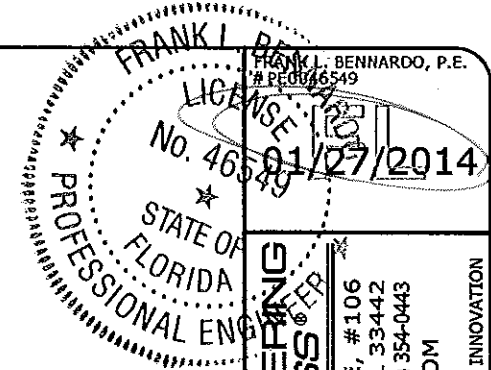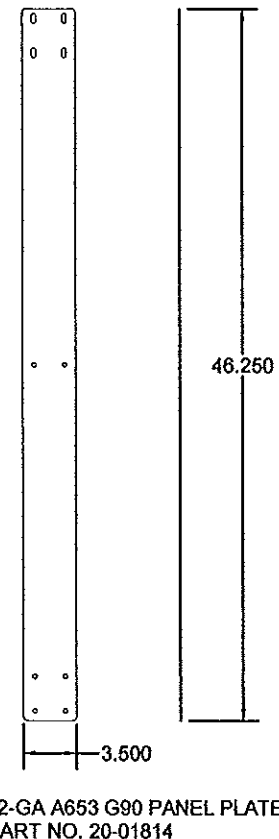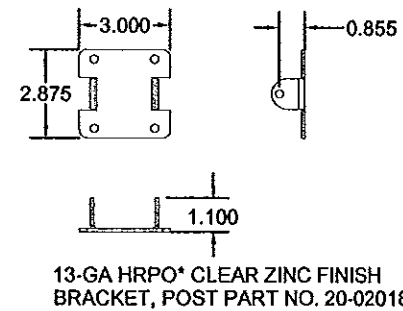

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
PH: (954) 354-0660 FAX: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #685
A FRANK L. BENNARDO, P.E., INC. INNOVATION


TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
VC-2 WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	CHKD	DATE
INIT ISSUE	05/06/13	KL	05/06/13
REV. PER COMMENTS	01/24/13	KL	01/24/13

Approved as complying with the
Florida Building Code
Date 03/13/2014
NOA# 13-052105
Miami Dade Product Control
By *[Signature]*

13-TKO-03
SCALE: 1/2"
PAGE DESCRIPTION:
7
6


VC-2 WL PANEL HARDWARE (CONTINUED)

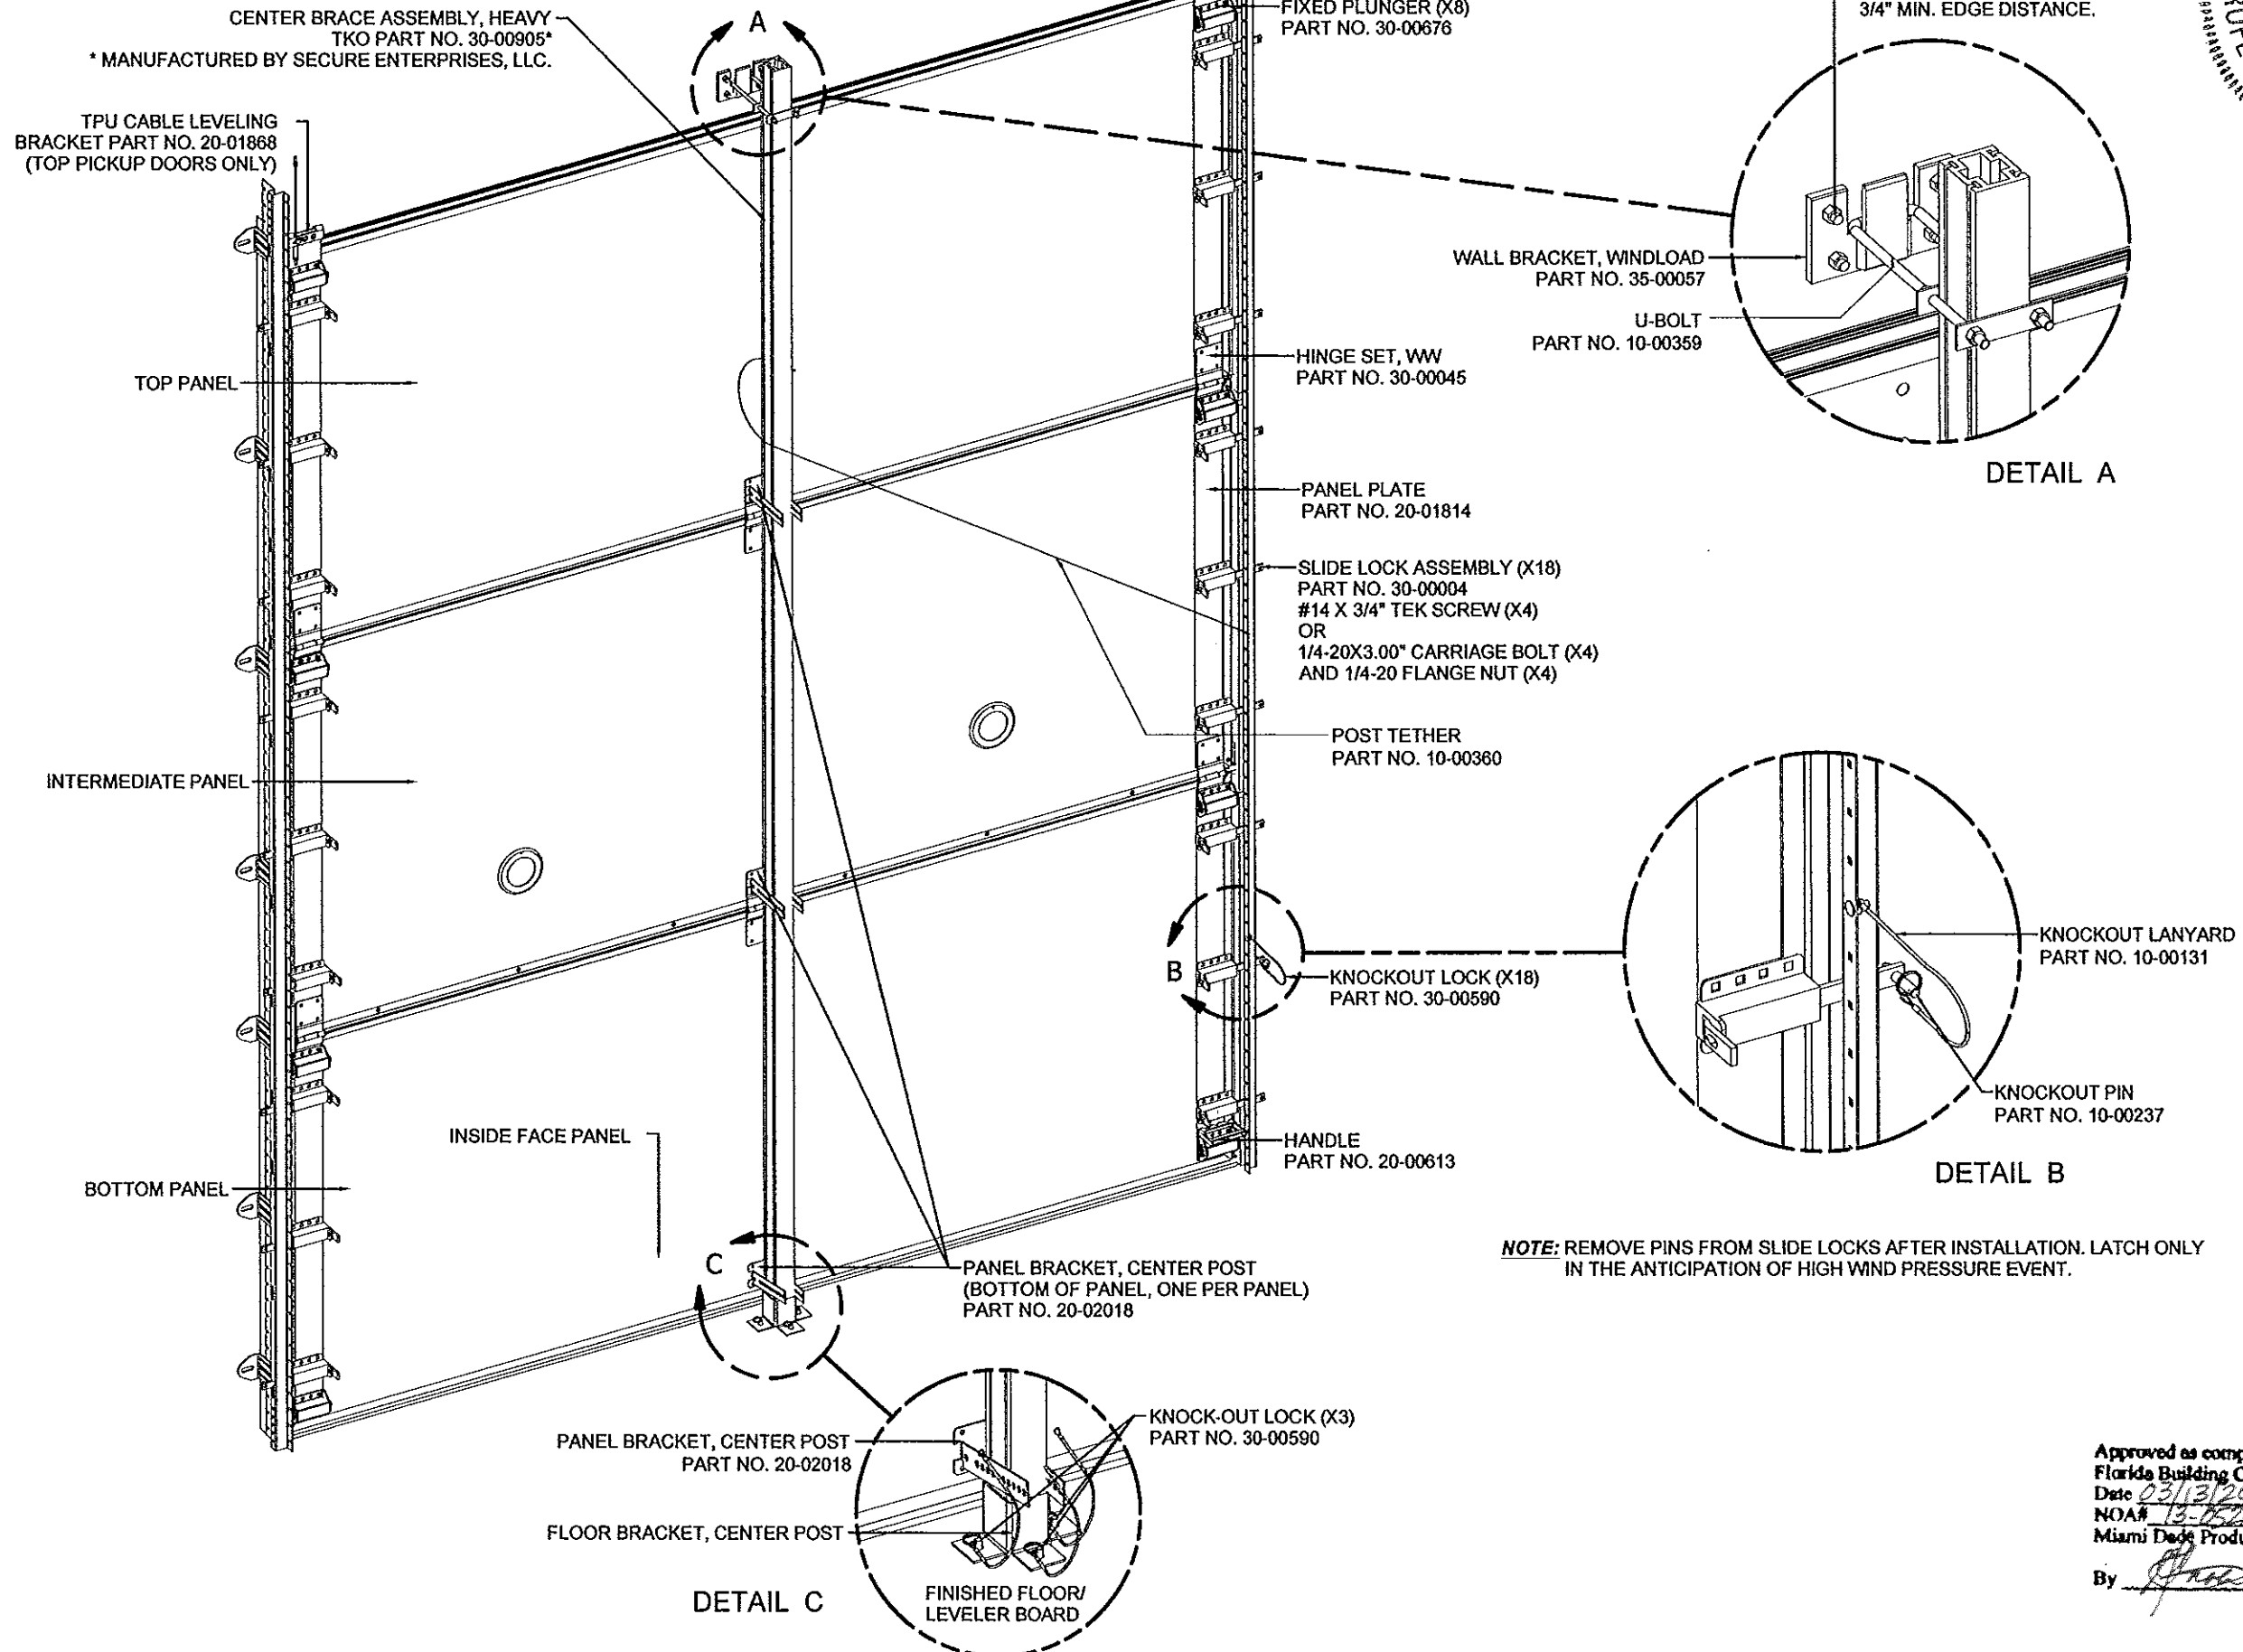

NOTE: REMOVE PINS FROM SLIDE LOCKS AFTER INSTALLATION. LATCH ONLY IN THE ANTICIPATION OF HIGH WIND PRESSURE EVENT.

Approved as complying with the
Florida Building Code
Date 03/13/2014
NOA# 13-0521-05
Miami Dade Product Control

By *[Signature]*

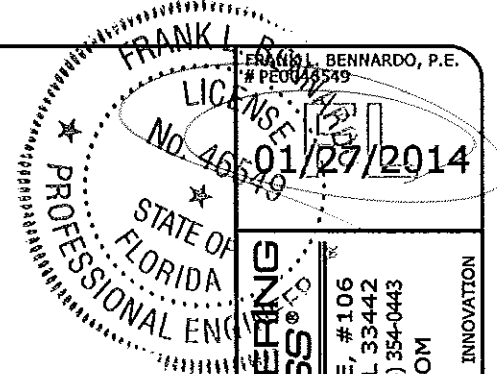

ENGINEERING EXPRESS
160 SW 12th AVENUE, #106
DEERFIELD BEACH, FL 33442
Ph: (954) 354-0660 Fax: (954) 354-0443
WWW.ENGEXP.COM
CERT OF AUTH #9885
A FRANK L. BENNARDO, P.E., INC. INNOVATION

TKO DOORS, DIVISION OF 4FRONT ENGINEERED SOLUTIONS, INC.
N56 W24701 NORTH CORPORATE CIRCLE, SUITE A
SUSSEX, WI 53089
PHONE: 1-800-575-3366 FAX: (262) 246-1301
FIBERGLASS DOCK DOORS
VC-2 WL OVERHEAD GARAGE DOOR
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE	DRWN	CHKD
INIT ISSUE	05/06/13	KL	FLB
REV. PER COMMENTS	01/24/13	KL	FLB

13-TKO-03
SCALE: 1/2"
PAGE DESCRIPTION: